35 WASHINGTON STREET, BRIGHTON **LICENSED SHARED HMO - 4 PEOPLE** **FIRE PRECAUTIONS PLANS**

NOTE: The house is provided with a Grade D fire detection and alarm system installed in accordance with the recommendations of BS 5839-6 comprising interlinked mains-powered smoke and heat alarms in the areas indicated by the blue symbols on the plans. The circulatory area escape route is also provided with non-maintained emergency escape lighting installed in accordance with the recommendations of BS 5266-1.

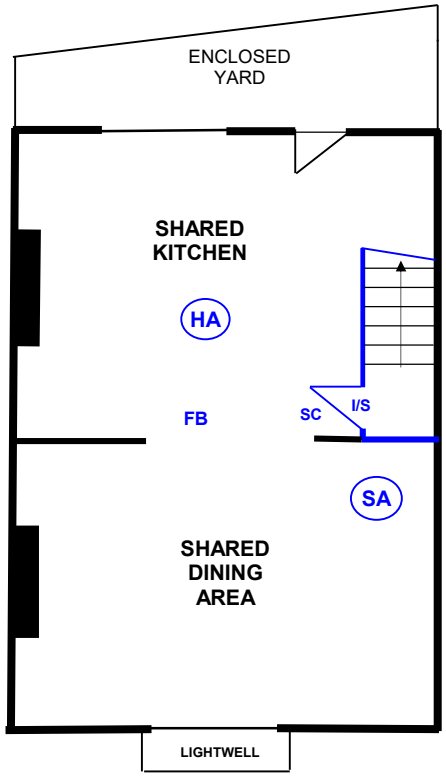

BASEMENT

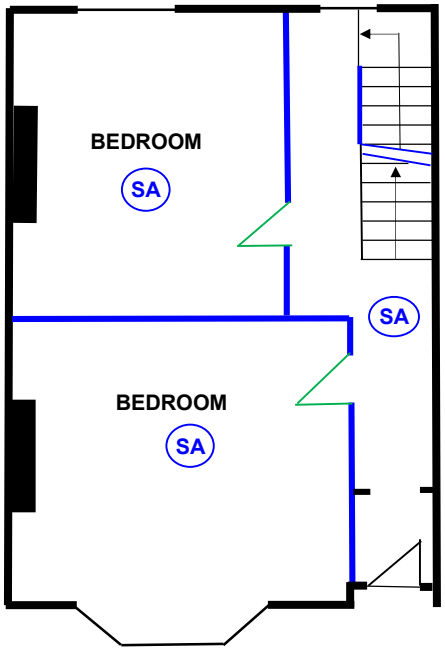

GROUND FLOOR

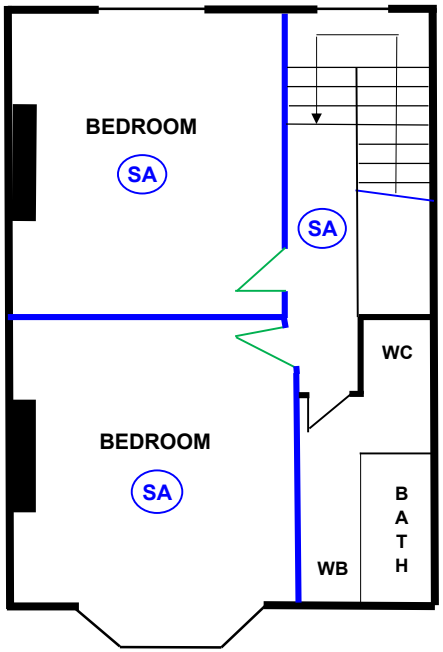

FIRST FLOOR

NOT TO SCALE MOE DRAWN BY: AJG MOE CHECKED BY: DATE: 11 March 2019	COLOUR PLAN. DO NOT TAKE BLACK AND WHITE COPIES **THIS PLAN IS COPYRIGHT, DO NOT TAKE COPIES WITHOUT AUTHORITY FROM BRIGHTON & HOVE CITY COUNCIL** HOUSING ACT 2004 - HMO LICENSING	Brighton & Hove City Council	ESFRS